


1. Intended use:



The RACK 19" cabinet enables integrating CCTV, AC, I&HAS, RTV, LAN, or other systems in small companies or households. It is intended for devices manufactured in enclosures of the 19" standard. Due to the RACK cabinets, the devices are aesthetically mounted and protected against mechanical damage.

2. Specifications:

SPECIFICATIONS	
Mounting dimensions:	W=19", H=9U, D=447mm
External dimensions:	W=600, H=502, D=600 [mm, +/-2]
Net/gross weight:	23,5 / 25 [kg]
Materials:	- RACK mounting rails: cold-rolled steel SPCC 1,5mm - top and bottom panel: cold-rolled steel SPCC 1,2mm RAL 9004 - frame: cold-rolled steel SPCC 1,2mm RAL 9004 - front door: 5mm toughened glass / SPCC 1,2mm RAL 9004 - side panels: cold-rolled steel SPCC 1,2mm RAL 9004 - rear plate: cold-rolled steel SPCC 1,2mm RAL 9004
Static load:	70 kg
Use:	inside, IP20
Notes:	- adjustable distance between front and rear RACK rails (range - see point 5.1) - ventilation holes in the top panel (2 x 105x105mm - mounting dimensions) - cable ducts in the top and bottom panel (340x56mm) - lockable front door – repeatable code (2 keys included) - possibility of reverse front door – opening left/right - side panels - lock assembly possible - RAZB16 (additional equipment) - possibility of disassembly rear panel (518x434mm) - ready-to-assemble
Declarations, warranty:	RoHS, 12 months from the date of purchase

3. Structure of the cabinet.

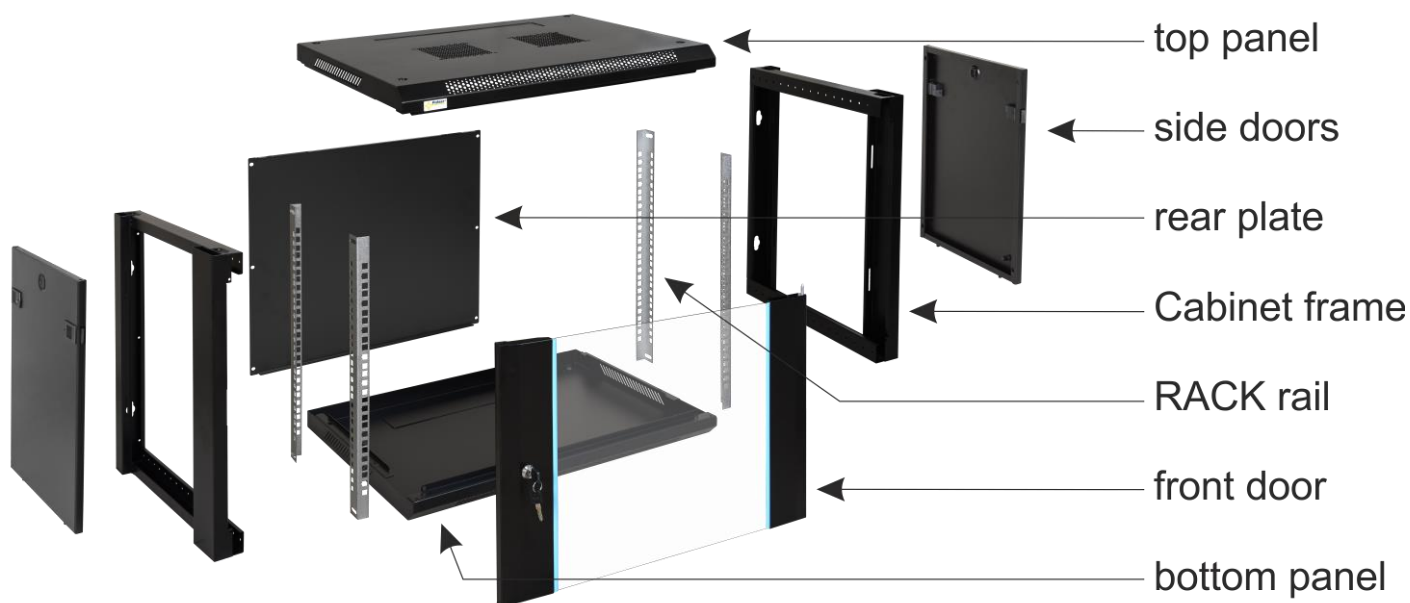

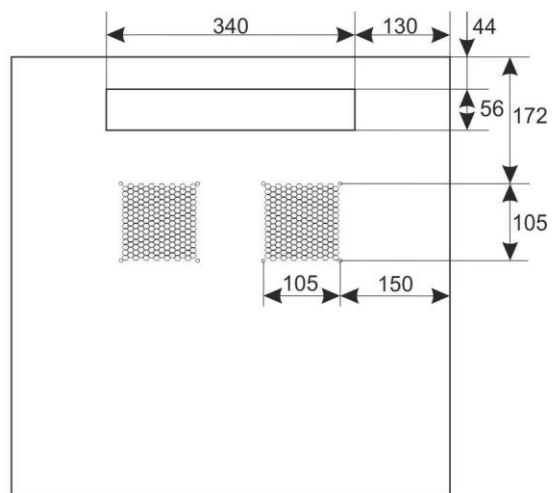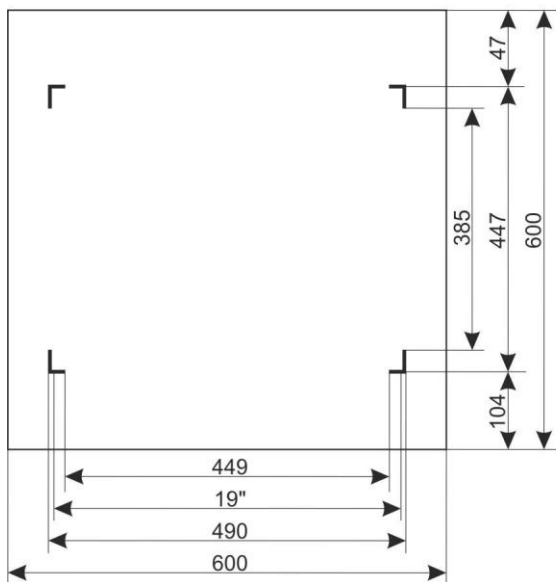


4. Components


Num ber	Component	Amou nt	Foto	Num ber	Component	Amou nt	Foto
1	Top panel	1 pcs		7	RACK 19" 6U rail	4 pcs	
2	Bottom panel	1 pcs		8	10mm screw cross (black)	18 pcs	
3	Front doors	1 pcs		9	M5 nut, spring washer	2 pcs	
4	Rear plate	1 pcs		10	Spacer for front doors	1 pcs	
5	Side panel	2 pcs		11	M6x12 Phillips screw	12 pcs	
6	Cabinet frame	2 pcs		12	M6 nut („cage nut“)	12 pcs	
				13	Cross and hex screwdriver	1 pcs	

5. Assembling instructions:

5.1)

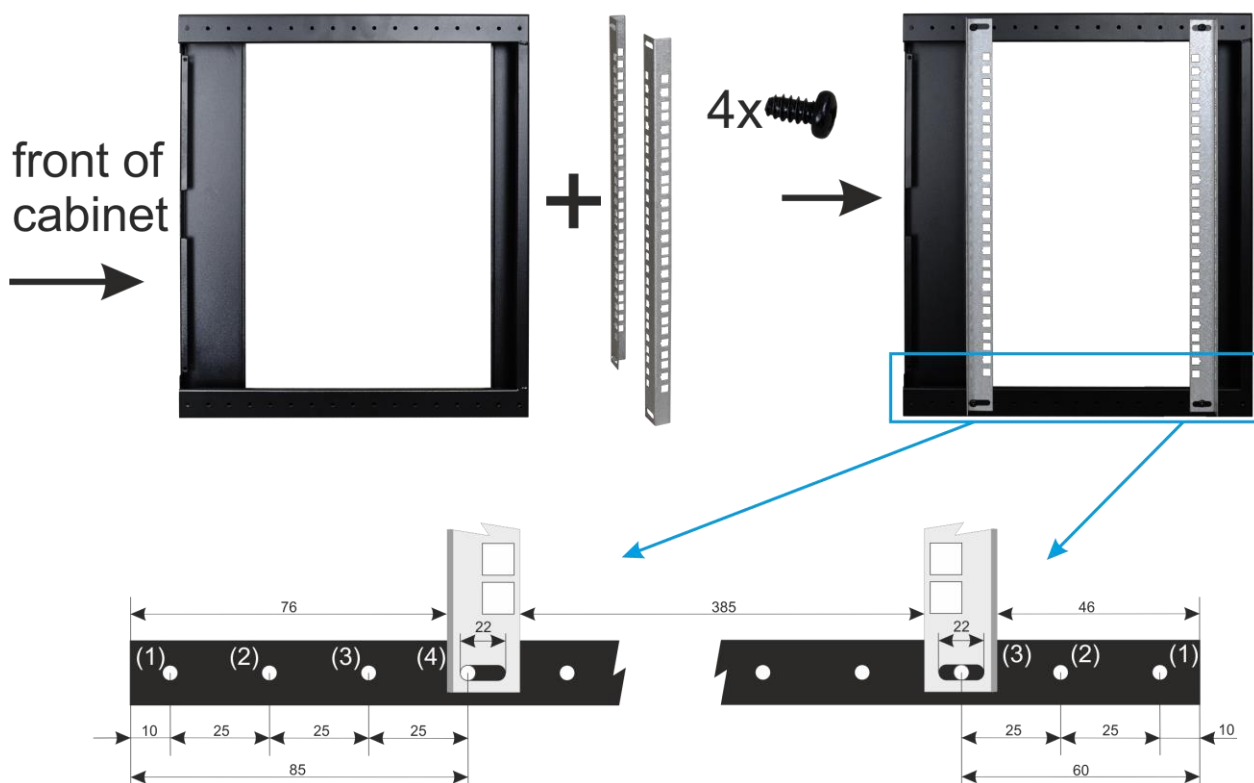


5.2)

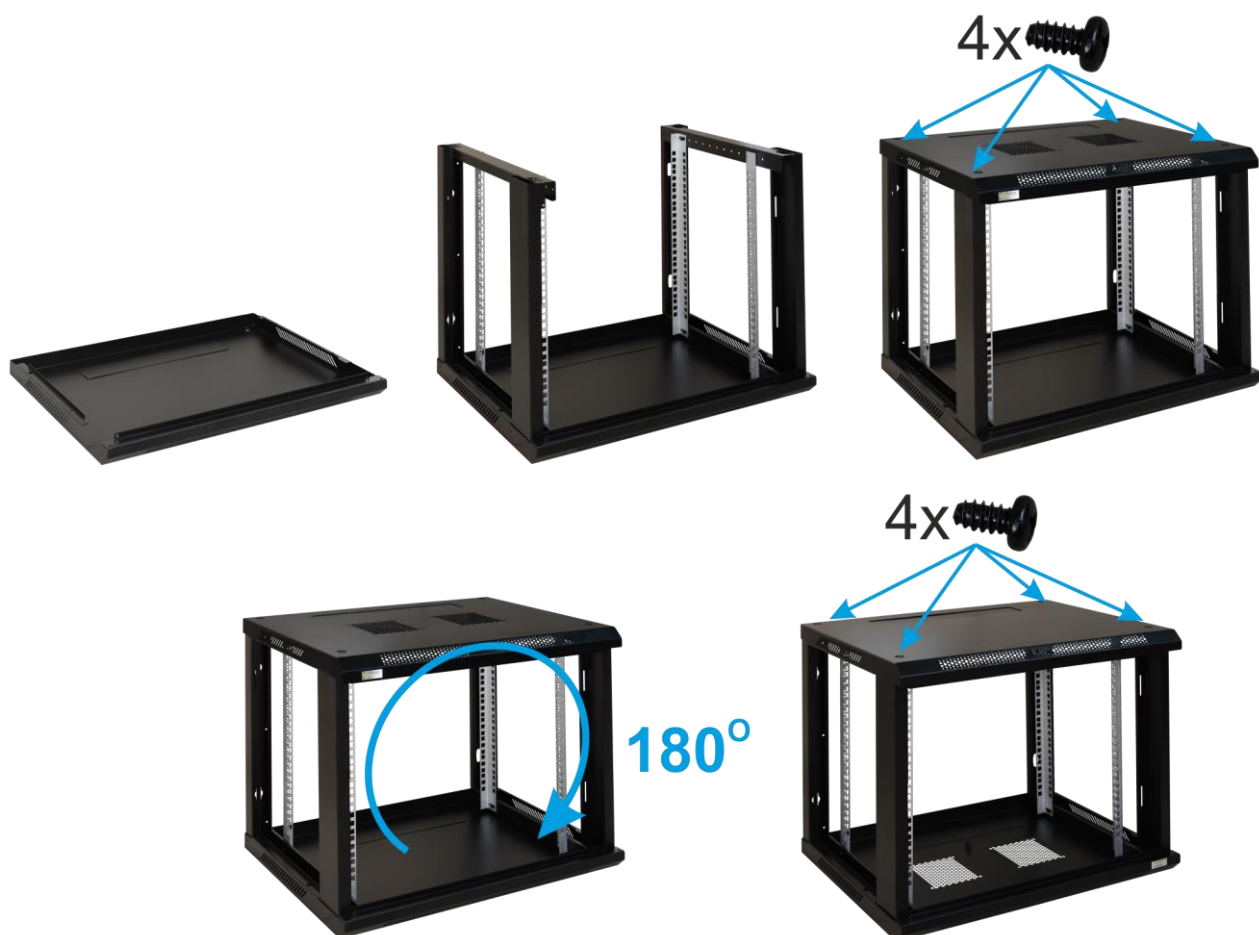

5.3)





5.4)

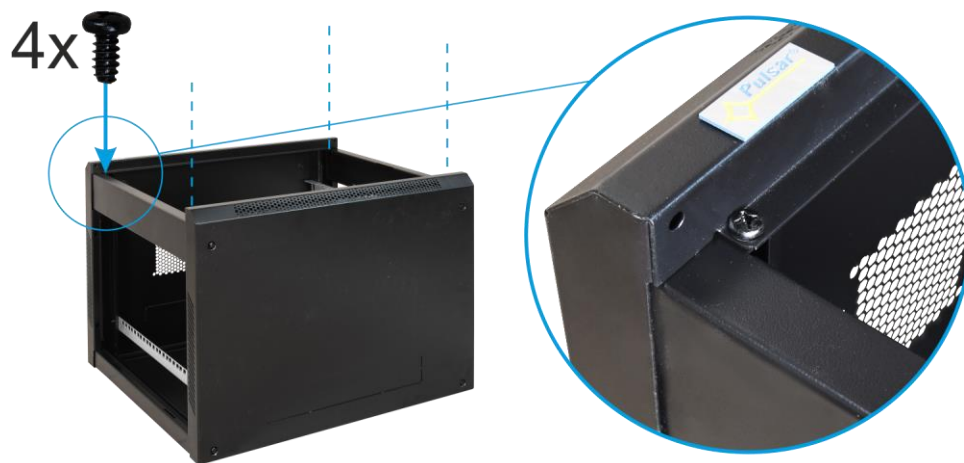




5.5)



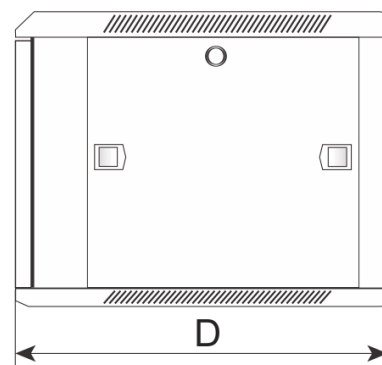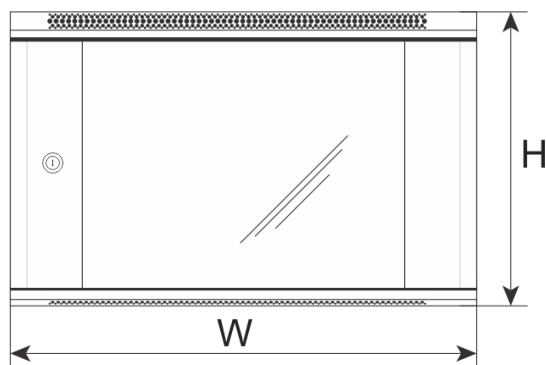

6. Assembly of RACK cabinet

Choose appropriate mounting pins depending on type of substrate.

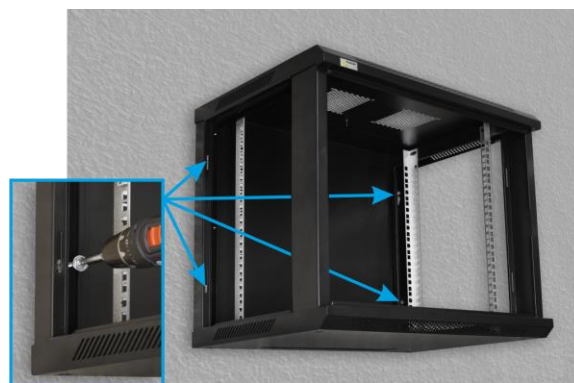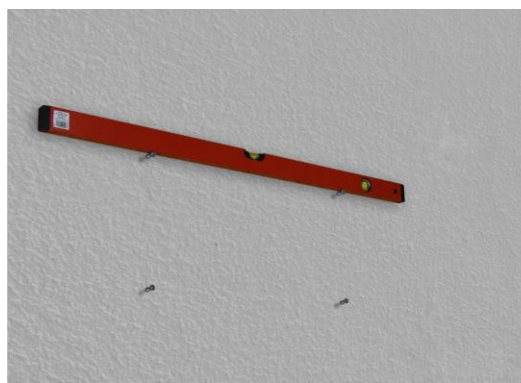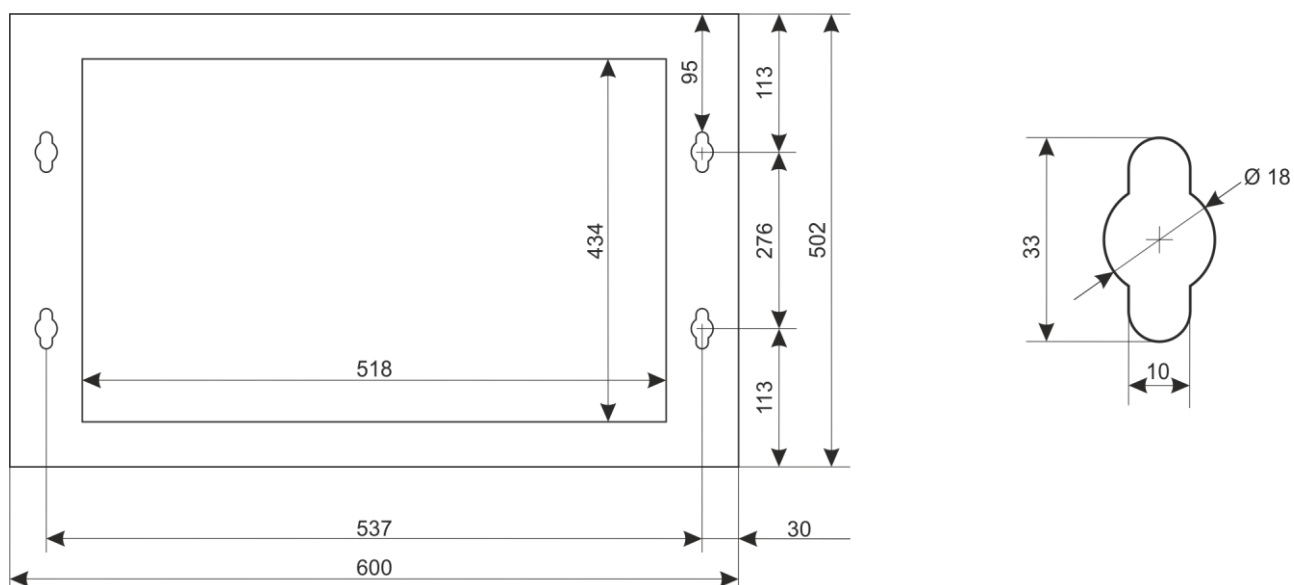

MANUFACTURER

Pulsar sp.j.

Siedlec 150,

32-744 Łapczyca

Tel. 14-610-19-40, Fax. 14-610-19-50

e-mail: biuro@pulsar.pl, sales@pulsar.pl

http:// www.pulsar.pl, www.zasilacze.pl